




# Q.C. Audit Report

Static Head (Ft. of H2O)	TD Head (Ft. of H2O)	Flow (GPM)	Amps	Watts
3.5	5.2	101.9	3.1	1531
8.2	9.3	82.2	3.0	1378
15.3	15.7	50.5	2.8	1169
19.0	19.2	27.5	2.8	1016
22.9	22.9	0.0	2.8	845
23.0	23.0	0.0	2.7	826
23.1	23.1	0.2	2.8	845

<b>Model Number:</b> G284	
<b>Part Number:</b> 003315	
<b>Volts:</b> 415	<b>Phase:</b> 3
<b>Tag Amps:</b> 2.6	<b>Hertz:</b> 50
<b>HP:</b> 1	
<b>Test Date:</b> 1/28/2010	<b>Test Number:</b> 38
<b>TD Head At CLV:</b> 23.1	<b>Amps At CLV:</b> 2.8
<b>GPM (OV):</b> 101.9	<b>Max Amps:</b> 3.1
<b>Low Volt Start:</b>	
<b>Motor Manufacturer:</b> GE	
<b>Production Date:</b> 1/28/2010	
<b>Operator:</b> jonb	
<b>Remarks:</b> G284@415v/50Hz	<b>Audit Results</b>
<b>Conclusion:</b>	<input type="text"/>
<b>Action:</b>	<b>Failure Reasons:</b>
	<input type="text"/>

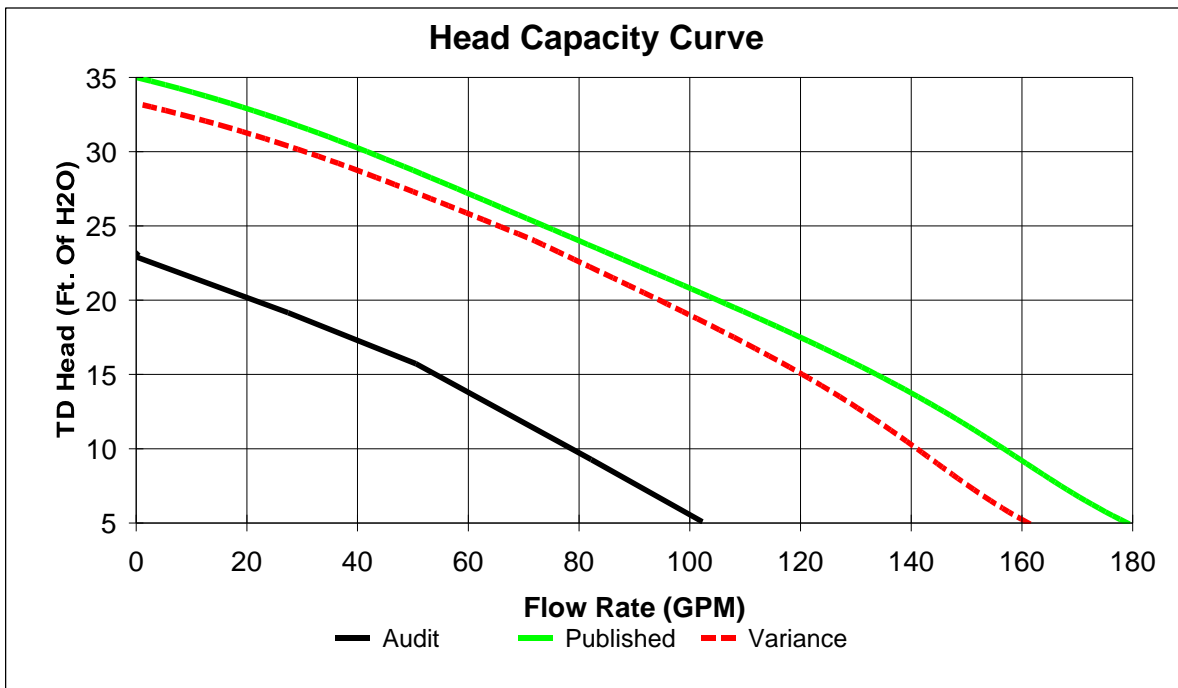

### Authorization

By: \_\_\_\_\_ Date: \_\_\_\_\_